



SolarEdge Home Battery 400V

Installation on StorEdge Inverter

Connection via RS485

Revision 1.5 March - 2023

solar**edge**

Distance, cables & Part Numbers

Technical data and Part Numbers

PN - HD WAVE	INVERTER DESCRIPTION - TECHNICAL SHEET HERE
SEXXXXH-XXXXXBXX4	StorEdge Single-phase inverter with HD-Wave technology, Inverter with SetApp configuration



PN - ACCESSORIES	DESCRIPTION
IAC-RBAT-RWYCBL-01	SolarEdge Energy Bank Branch Connector set (10 pairs in a box)
IAC-RBAT-HANDLE-01	SolarEdge Energy Bank Mounting Handles (4 handles in a box)
IAC-RBAT-FLRSTD-01	SolarEdge Energy Bank Floor Stand

*Even the SetApp inverters with meter and integrated Sesti are compatible with the SolarEdge Home Battery 400V.

Allowed distance between inverter & batteries

The maximum distance allowed between the inverter and the battery is 50m

In the case of Multi-Inverter and Multi-Battery systems, the maximum distance of 50m should be understood as the distance between the Leader inverter and the physically farthest battery

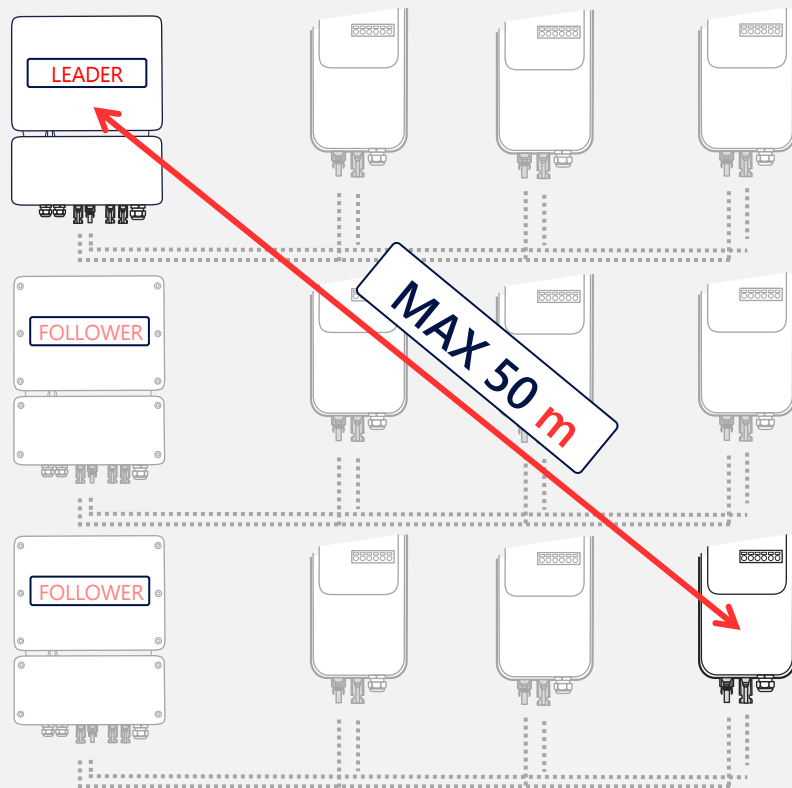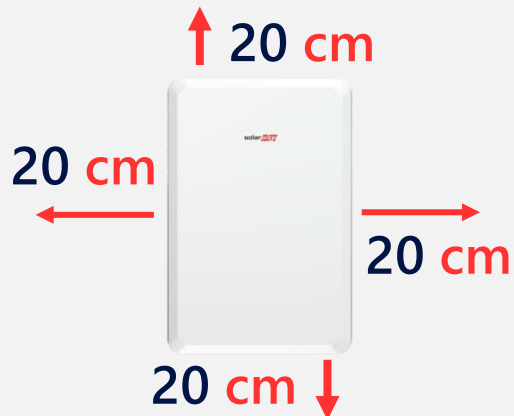

Communication and power cable specifications

INVERTER / METER Communication	Cable Type
Type of connection cables between Inverter and Meter	Shielded cable with at least 3 twisted conductors with a section of 0.2–1 mm ² . A CAT 5/6 STP cable can be used
INVERTER / METER Communication	Max Distance
Max distance of RS485 cable between inverter and meter	100 m with category 5/6 cable
	1000 m with RS-485 category cable
DC CABLES BATTERY/INVERTER	CABLE TYPE
Type of DC cables between the battery and Inverter	6 mm ² (6–10 mm ²), 600 V insulated
Type of grounding cable	6 mm ² (6–10 mm ²)

Please Note: The connection must use twisted cables for terminations A & B (eg. the Blue cable for A & the White/Blue for B). We recommend the use of Cat5/6 shielded Ethernet cable with the same colors shown in this manual

Power on & off



Attention


The "SolarEdge Home Battery 400V" must be turned off before installation. Failure to follow the correct battery shutdown/ignition procedure may damage the product. This type of damage, deriving from installation negligence, puts the product out of warranty.



The SolarEdge battery communicates with the inverter via RS485, this type of communication excludes the Home Network connection.

Switch ON/OFF/P

Disconnecter

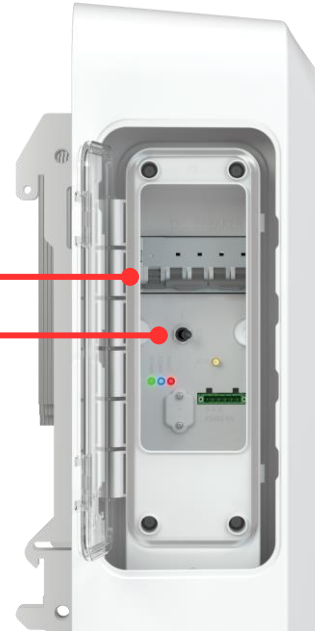


Inverter and battery shutdown procedure

- 1 – Set the inverter **Switch P/1/0** to **0**
- 2 – Check that the inverter **Vdc** reaches a **safety voltage** (less than 50V)
- 4 – Turn the battery **ON/OFF/P Switch** to **OFF**
- 5 – Set the battery **disconnector** to **OFF**

Battery & inverter start-up procedure

- 1 – Make sure that the **inverter Switch P/1/0** is in position **0** & the Vdc is less than 50v
- 2 – Set the **battery disconnector** to **ON**
- 3 – Turn **ON** the battery **ON/OFF/P Switch**
- 4 – Set the inverter **Switch P/1/0** on **1**

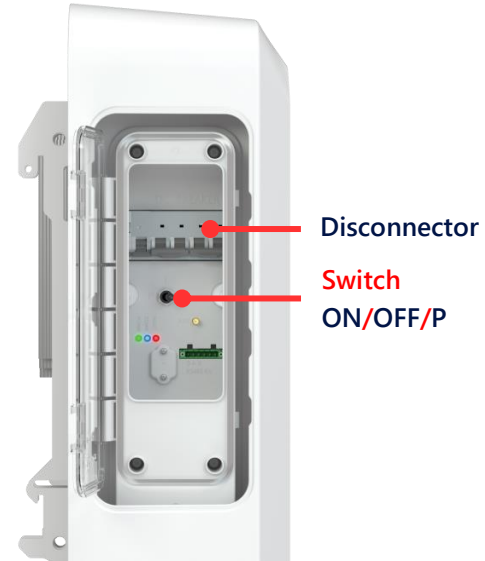

Wiring




Attention

Before wiring the battery and the inverter, please perform the **shutdown procedure** indicated on page **8** of this manual.

We then invite you, in order to have a clearer view of the installation, to wire the **battery using the same colors** used in this guide.


Once the wiring has been completed, it is also extremely important to make sure that the polarity has not been inverted. **An inversion of polarity may result in the invalidation of the product warranty.**


 The following pages show different connection modes between inverter and battery according to the various installation possibilities: An inverter with a battery, an inverter with a maximum number of 3 batteries in parallel and, finally, several inverters in Leader/Follower connection all with a maximum number of 3 batteries per inverter in parallel.


For the configuration of your system, please refer to the pages of your interest only.


Configuration 1: DC connections on a single battery



DC connections of the batteries to the inverter




 The SolarEdge Home battery must be connected, to the StorEdge inverters, using the input dedicated to the StorEdge and not those for the PV strings.





 For the DC connection use a 6mm² (6-10mm²), 600V insulated cable. Connect the ground cables as indicated in the "Quick Installation guide".

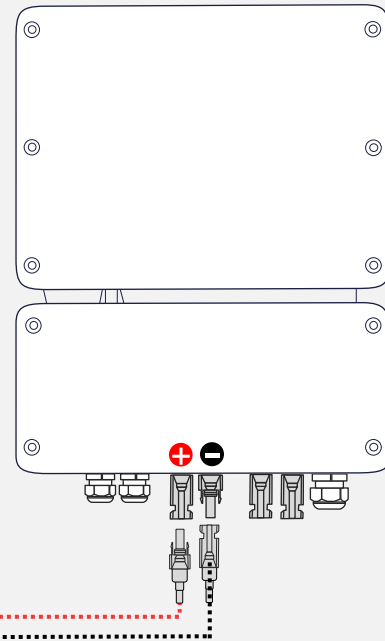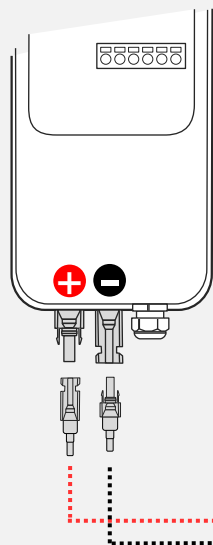



DC connections of the batteries to the inverter




 The SolarEdge Home battery must be connected, to the StorEdge inverters, using the input dedicated to the StorEdge and not those for the PV strings.



 For the DC connection use a 6mm² (6-10mm²), 600V insulated cable. Connect the ground cables as indicated in the "Quick Installation guide".




 We recommend using SolarEdge cables for parallel connection of batteries with PN: **IAC-RBAT-RWYCBL-01**

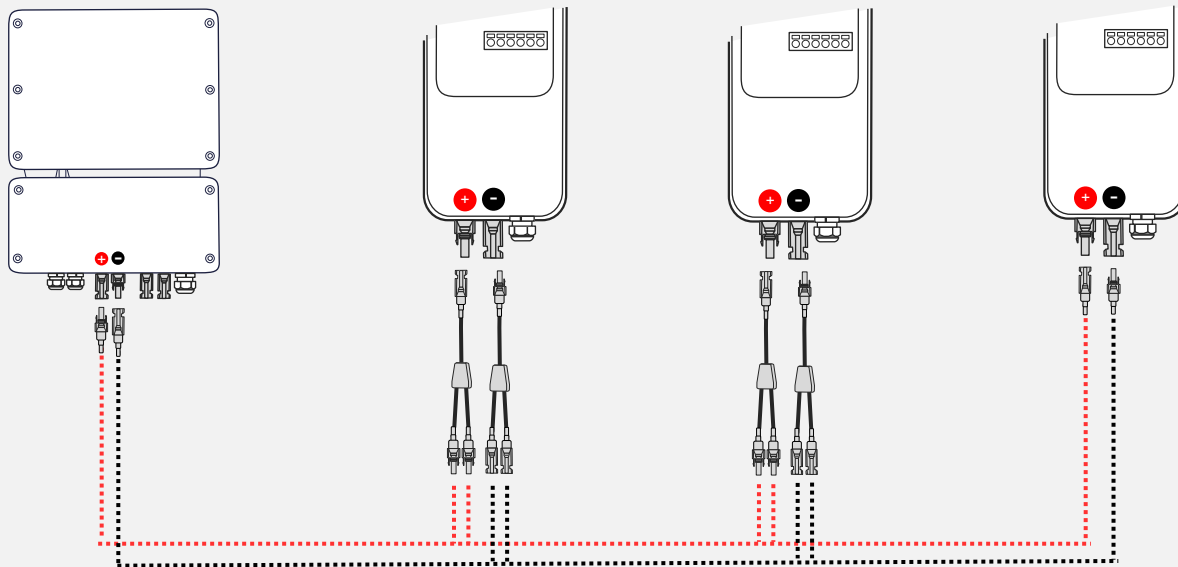

Configuration 1: RS485 connections on a single battery

RS485-1 connection between battery, inverter & meter

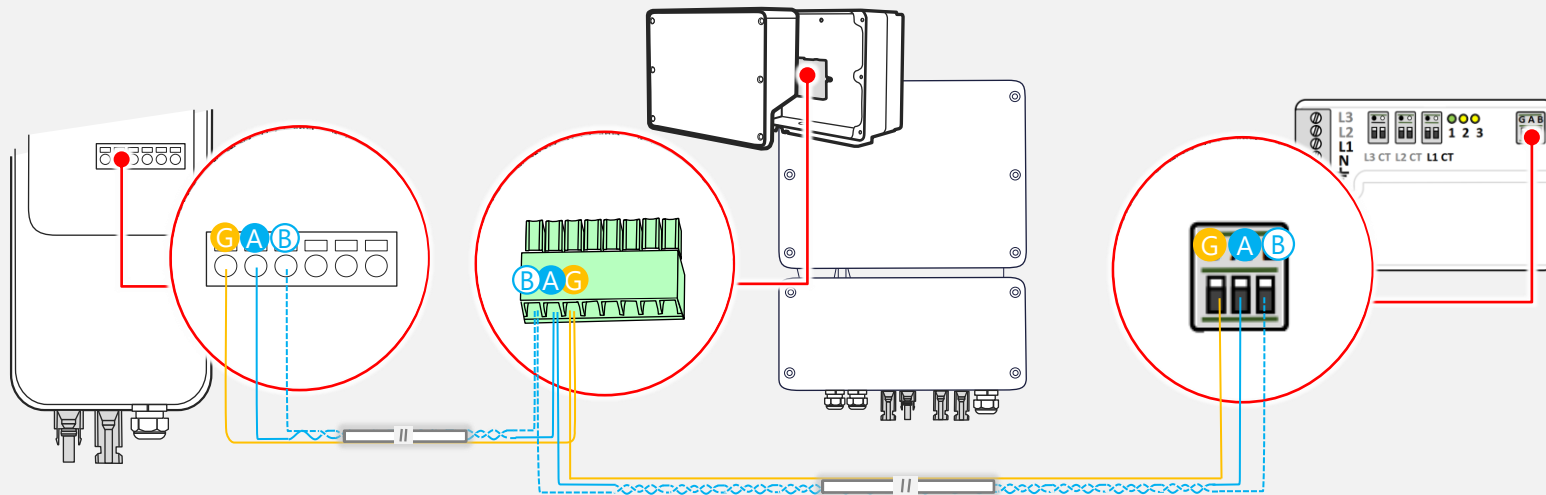


- G = Orange
- A = Blue
- B = White/Blue

⚠ Use only the **RS485-1** port for communication connections between inverter, battery and meter. Please use the same wire colors as shown on this sample page.

Configuration 2: RS485 connections in Multi-Battery Systems

RS485-1 connection between batteries, inverter & meter

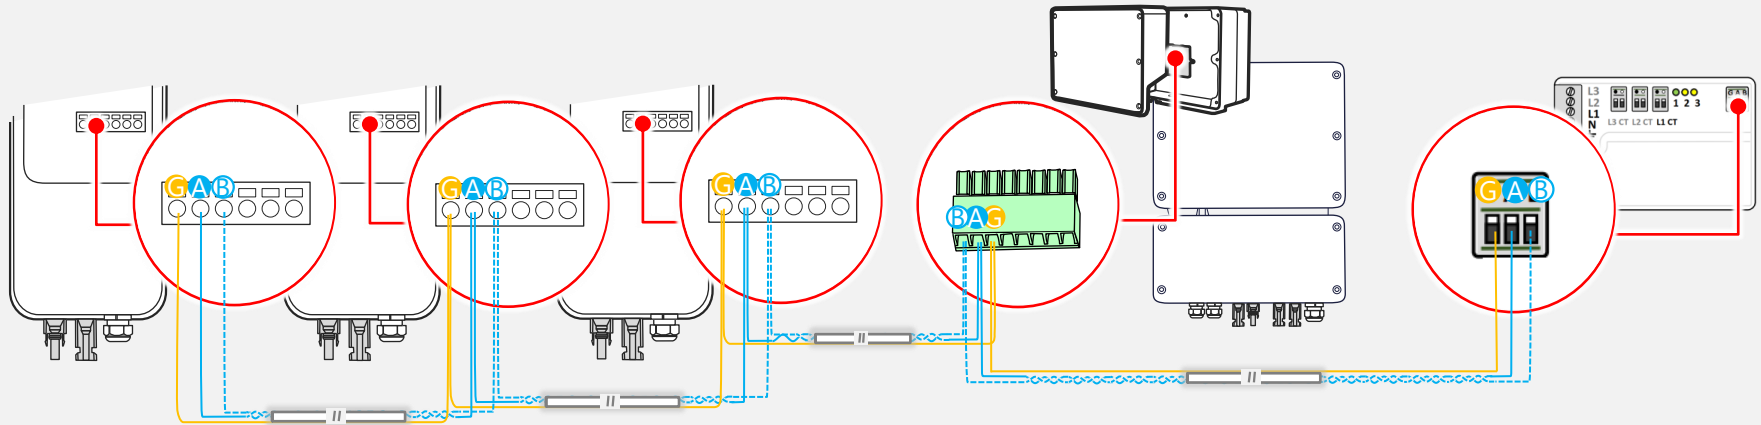


- G** = Orange
- A** = Blue
- B** = White/Blue

⚠ Use only the **RS485-1** port for communication connections between inverter, battery and meter. Please use the same wire colors as shown on this sample page.


Create a Leader/Follower Communication

1



Use the RS485-2 communication bus for the Leader/Follower connection between the inverters.


Use the RS485-1 communication bus for communication between the inverter, meter and the batteries to be associated with it as indicated on page 14. The Meter must be connected on the same RS485-1, used for the connection with the batteries, **of the Leader inverter only.**



2



Set the SW2 DIP switch to ON (high) to terminate the first and last inverters in the RS485 bus.

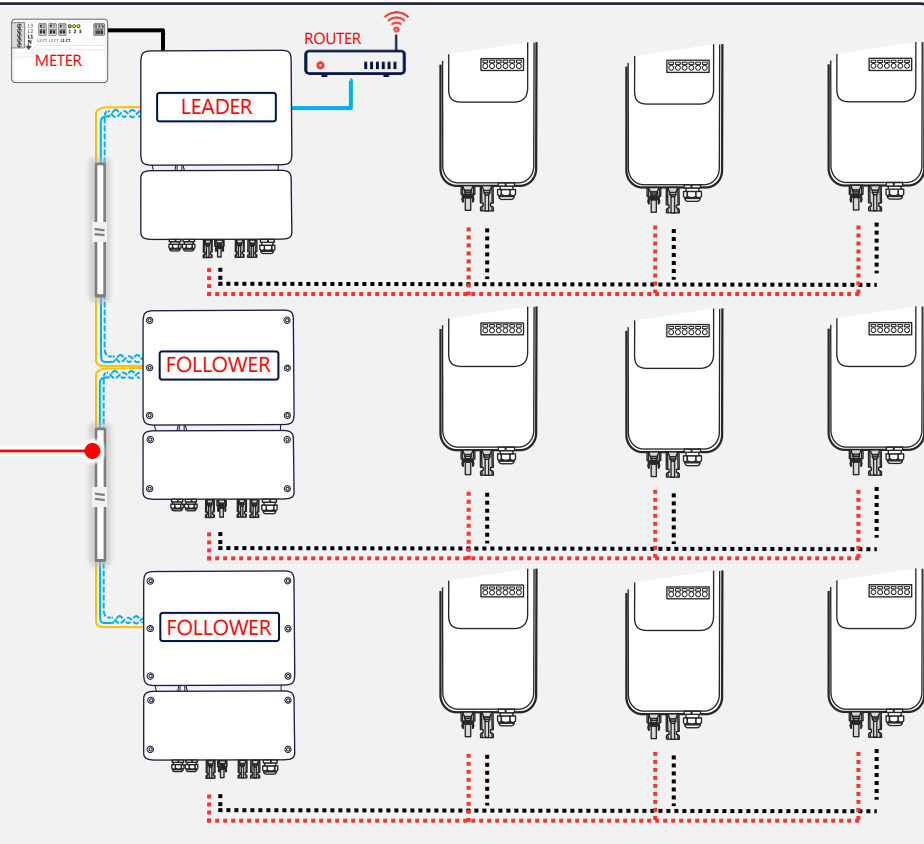

Commissioning





Attention

In the event of a Multi-Inverter/Multi-Battery connection, please be aware that the search, pairing, updating, and self-test of the batteries must all be performed by each inverter singularly.

Only after completing all the steps above indicated, in all the inverters, is possible to connect the full system in leader\follower communication and complete the commissioning by setting the Energy Control Mode by the inverter leader.


Attention

 Before turning on the batteries, the inverter must also be turned off on the AC side.


 To avoid electric shock, refer to the safety instructions in the inverter installation guide before removing the inverter cover.

1. Inverter & battery shutdown

1 Turn off the inverter ON/OFF/P switch and the DC safety switch (if applicable).




2 Wait five minutes.




3 **Turn off the battery:**
Turn the battery ON/OFF/P switch to OFF


Set the battery disconnecter to OFF.




4 Turn off the AC power to the inverter on the main power panel.




2. Switch on the devices in the order indicated

 Please pay particular attention to the ignition process of the products.


The SolarEdge Home battery must be turned on before the inverter, according to the methods indicated alongside.




1 **Turn on the battery:**
Set the battery disconnecter to ON
Turn ON the battery ON/OFF/P switch




2 Turn on the AC power to the inverter on the main power panel.







3 Turn on the inverter ON/OFF/P switch and DC safety switch (if applicable).



3. Check for errors






Power	Comm.	Error	All LEDs ON Start/Reset
			
Flashing Upload/Download	ON Communication OK	ON Error	
Flickering Standby/Pairing	Flashing In search of network	Fast Flashing FW Update	


 Once the SolarEdge Home battery is turned on, before powering the inverter, make sure that **no red light is on** but that the blue is flashing.

If there is a red error light, please move the **ON/OFF/P switch to P for 5 seconds**.

Once the error has disappeared, turn the battery off and on again as described in this manual.

4. Connection Via SetApp and Battery Communication Check

- 1 Enable internet and GSP in the phone 
- 2 Start SetApp 
- 3 Scan the QR code on the inverter. 



Commissioning
✓
Device Manager
✓
New device found

Important Notice

The SolarEdge Home battery **must not be added** to the «Site Communication» menu but is automatically identified under the device manager menu. When this happens, the item "**Found new devices**" is visible in red

If this wording is not visible, the battery is not communicating, and you must:

- 1 - Check the RS485 communication wiring again
- 2 - Be sure that the battery is connected with the meter to the RS485-1 under "Multi-Device" protocol.

SetApp Configuration

SetApp: Adding devices and battery update

21

The SolarEdge Energy Bank battery **must not be added** in the «Site Communication» menu but is automatically identified under the device manager menu. When this happens, the item «**New devices found**» is visible in red

The screenshots illustrate the following steps:

- Commissioning Menu:** The 'Device Manager' option is highlighted in red, with the text 'Found New Devices' below it.
- Device Manager - Available Devices:** Two 'Home Battery' devices are listed. A red box highlights the 'Add Selected' button.
- Installing Firmware - StorEdge:** A progress bar shows 21% completion. Below is a table of components to be updated:

Controller	Installed	New
StorEdge		
SEDG Comm	1.0.20	1.0.67
SEDC DCDC	0.0.60	0.0.79
SEDC BMS	0.5.70	0.6.5

- Installing Firmware - StorEdge:** A green checkmark indicates successful installation. A red box highlights the 'Continue' button.
- Update Duration:** A timer shows 60/75 MIN. A text box states: 'The SolarEdge Home Battery update, via RS585, can take up to 75 minutes to complete.'

SetApp: Battery self-test and and Control Mode

Start the battery self-test to verify correct charging, discharging, and communication. In Multi-Inverter/Multi-Battery systems, the Energy Control mode can be set **by the Leader inverter after the leader/follower chain has been created.**

The screenshots illustrate the following steps:

- Device Manager**: Home Battery 400V - Configure
- Self-Test Home Battery 400V**: Start Self Test
- Autotest Home Battery 400V**: Warning High Voltage - Continue
- Autotest Home Battery 400V**: Continue
- Autotest Home Battery 400V**: Energy Control Mode - Set (to MSC)



Red boxes highlight the 'Start Self Test', 'Continue', and 'Set' buttons. A red arrow points from the 'Set' button to the text box on the right.

Set the battery operation mode to **Maximum Self Consumption (MSC)**. Then check from the status section that the batteries have started working.

Configuration 3: Connections in Multi-Inverter/Battery Systems

Complete the Leader/Follower detection via SetApp

Connect to the first or last inverter in the chain, as indicated on page 15, to set the Leader inverter.



- Site Communication
- RS485-2
- Protocol – SolarEdge Follower
- Protocol – Follower
- SolarEdge Leader
- Follower detect

The screenshots show the following steps:

- Commissioning**: The 'Site Communication' option is highlighted in red.
- Site Communication**: The 'RS485-2' option is highlighted in red.
- RS485-2**: The 'SolarEdge Follower' protocol is highlighted in red.
- RS485-2 Protocol**: The 'Follower' role is selected with a checkmark.
- RS485-2 Protocol Role**: The 'SolarEdge Leader' role is selected with a checkmark.


The next three screenshots show the 'Follower Detect' process:

- RS485-2 Protocol**: The 'Follower Detect' option is highlighted in red.
- Follower Detect**: Shows '0 Followers detected' and 'Performing Follower Detect'.
- Follower Detect**: Shows '0 Followers detected' and 'Follower Detect Completed'. The 'Done' button is highlighted in red.

Disconnection

SetApp: Disconnection from the inverter

Once the commissioning of the inverter and battery has been completed, it is important to disconnect from the inverter, using the appropriate button of the application. Only in this way, in fact, will the monitoring portal be updated with the new components installed.

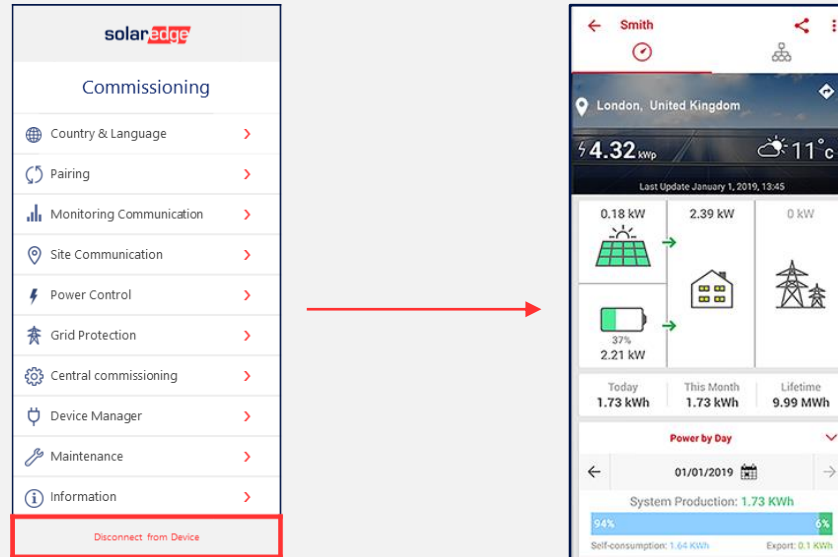

Thank You!

Cautionary Note Regarding Market Data & Industry Forecasts

This power point presentation contains market data and industry forecasts from certain third-party sources. This information is based on industry surveys and the preparer's expertise in the industry and there can be no assurance that any such market data is accurate or that any such industry forecasts will be achieved. Although we have not independently verified the accuracy of such market data and industry forecasts, we believe that the market data is reliable and that the industry forecasts are reasonable.

Version #: V.1.0

Version #: 12/2018/EN ROW

solaredge