



Technical Investigation

Compliance of SolarEdge Battery Energy Storage technology with PAS 63100:2024


Client: **SolarEdge Technologies (UK) Ltd**

Status: For Issue

Date: 23 November 2024



Client: SolarEdge Technologies (UK) Ltd
Project: Compliance Battery Energy Storage technology with PAS 63100:2024
Reference: PR2254
Document: Report
Status: For Issue

	Checked by
Name	James Hoare CEng FIET FEI
Signature	
Date	23/11/2024

Every effort has been made to ensure that the information contained within this document is accurate and true based upon the information available however LHW Partnership LLP cannot be made liable for any errors, omissions or losses resulting from the information contained within this report.

Contents

1. Introduction
2. Conclusion
3. Checklist for verification against PAS 63100: 2024
4. Electrical Installation
5. System Controls & Integration
6. Storage Batteries4.
7. Power Conversion Equipment
8. System Marking, Notices and instructions

Appendix

PAS63100 2024

1.0 Introduction

- 1.1.1 LHW were engaged by SolarEdge Technologies (UK) Ltd to review the compliance of the Battery Energy Storage (BESS) range of products with the specification PAS63100:2024 Electrical installations – Protection against fire of battery energy storage systems for use in dwellings – Specification
- 1.1.2 The products reviewed were the SolarEdge Home Battery range and single and three phase home hub inverters.
- 1.1.2.1 The PS63100:2024 specification relates to both the supply, installation and location of the BESS system, and the review was undertaken in the context of the SolarEdge BESS equipment when reviewed against Annex B of the document which asks for a response in the form “Conformant”, Non Conformant or Not Applicable (N.A).

2.0 Findings

- 2.1.1 Of the 35 sections of PAS63100:2024 Appendix B requiring a response it was found that there were:
- 24 Conformances
 - 10 were “Not Applicable” as some of the requirements in the document pertain to the installation and were not applicable to the equipment, and were classed as N.A.
 - There was one acknowledged section without a response provided (6.3.1) but an explanation was provided outlining the reason.
- 2.1.2 The review has concluded that the Battery Energy Storage equipment if installed correctly and located appropriately would comply with the PAS63100:2024 specification.
- 2.1.3 A copy of the review is included in the following section.

3.0 Checklist for verification against PAS 63100: 2024

- 3.1.1 On page 23 of the PAS 63100: 2024 Document the criteria for the review are outlined. A full copy of PAS63100:2024 I include in the appendix

4.0 Electrical Installation

Clause	Subject	Means of Verification	Conformant / Non Conformant / N.A.	Comments
4.1.1	Battery installed in accordance with BS 7671	Inspection and test in accordance with BS 7671. An Electrical Installation Certificate and associated schedules of circuit details and test results should be provided.	Conformant	
		NOTE Details of the extent of the installation, and installation location, should be provided on the Electrical Installation Certificate produced in accordance with the guidance in BS 7671, Appendix 6 and referenced in "Verifier notes"	Conformant	
4.1.2	Overcurrent protection of parallel strings of batteries	Inspection	Conformant	This is managed by Safe DC in the inverter.
4.2.1	Access to DC connections	Inspection	Conformant	
4.2.2	Access to DC fuses	Inspection	Conformant	No fuses installed in single or 3 phase battery systems, Safe DC manages this.

5.0 System Controls & Integration

Clause	Subject	Means of Verification	Conformant / Non Conformant / N.A.	Comments
5.1.1	System controls to BS EN IEC 62933- 5-2	Inspection or manufacturer conformity statement provided	Conformant	
5.1.2	System includes a BMS	Functional test or manufacturer conformity statement provided	Conformant	
5.2	Failure mode indications and warnings	Functional test or manufacturer conformity statement provided	Conformant	
5.3	Identification of controls, indications and warnings	Inspection or manufacturer conformity statement provided	Conformant	
5.4	Interfaces with fire detection and alarm and fire suppression systems	Manufacturer conformity statement provided	Conformant	With the addition of the Fire Fighter Gateway, it is possible to link to the fire alarm system.

6.0 Storage Batteries

Clause	Subject	Means of Verification	Conformant / Non Conformant / N.A.	Comments
6.1.1	Batteries housed in non-combustible enclosures including overcurrent protection	Inspection	Conformant	
6.1.2	Enclosure accessible only by key or tool, with top surface being IP4X or IPXX/D	Inspection	Conformant	
6.1.3	Single enclosures not to exceed 20 kWh of storage	Inspection or manufacturer conformity statement provided	Conformant	
6.2.1	Battery enclosure assemblies conform to BS EN IEC 62933- 5-2 and relevant parts of BS EN IEC 62485 series	Inspection of manufacturer's documentation, or conformity statement provided	N.A.	

6.2.2	Storage battery systems installed in accordance with BS 7671	Verified under 4.1.1	Conformant	
6.3.1	Arc flash risk assessment	Inspection of manufacturer's documentation, or conformity statement provided	Not Seen	This is not provided due to the management of Safe DC
6.3.2	Arc flash incident energy level	Inspection	N.A.	
6.3.3	Battery location based on arc flash risk assessment	Inspection	N.A.	
6.4	Battery cell and/ or monobloc standard.	Inspection of manufacturer's documentation or conformity statement provided	Conformant	
6.5.1	Battery located outdoors where practicable	Inspection (If it is not practicable to install batteries in accordance with this requirement, the verifier should provide a reference to the reasons given by the installer)	Conformant	
6.5.2	Batteries on external wall not to compromise fire performance of external wall	Inspection	N.A.	
6.5.3	Fire resistance of locations where batteries are installed if they cannot be installed outdoors	Inspection	N.A.	
6.5.4	Ventilation of battery locations if installed indoors	Inspection (not applicable if installed outdoors)	N.A.	
6.5.5	Batteries not to be installed in certain locations	Inspection	N.A.	
6.5.6	Provision of fire detection and fire alarm systems	Inspection (not applicable if batteries are not located in a location visited infrequently)	N.A.	
6.5.7	Limitation of total stored energy in batteries based on location	Inspection	N.A.	
6.6	Mechanical impact protection	Inspection of manufacturer's documentation or conformity statement	Conformant	

	(not applicable if batteries are not installed in a location listed in Table 5)	Conformant
--	---	------------

7.0 Power Conversion Equipment

Clause	Subject	Means of Verification	Conformant / Non Conformant / N.A.	Comments
7.1	Product standard for power conversion equipment	Inspection of manufacturer's documentation or conformity statement provided	Conformant	
7.2	Fire detection and fire alarm for PCE installed in certain locations	Inspection (not applicable if PCE is not located in a location visited infrequently)	N.A.	
7.3	Mechanical impact requirements for PCE installed in certain locations	Inspection of manufacturer's documentation, or conformity statement provided	Conformant	

8.0 System Marking, Notices and instructions

Clause	Subject	Means of Verification	Conformant / Non Conformant / N.A.	Comments
8.1	Marking of component products	Inspection of manufacturer's documentation, or conformity statement provided	Conformant	
8.2.1	Warning and user instruction notices provided in accordance with BS 7671	<i>Verified under 4.1.1</i>	Conformant	
8.2.2	Instruction notice for the presence of a battery storage system	Inspection	Conformant	
8.3	System user instructions	Inspection	Conformant	

I have reviewed the SolarEdge Battery Energy Storage technical solutions for adoption in a residential installation, and in my opinion conform with the requirements of PAS63100:2024

Signed



for and behalf of **LHW Partnership LLP**

Position

Engineering Consultant and Partner

Print Name.

James Hoare CEng FIET FEI

Date

23 November 2024

Appendix

PAS 63100:2024

Electrical installations – Protection against fire of battery energy storage systems for use in dwellings – Specification



Department for
Energy Security
& Net Zero



Publishing and copyright information

The BSI copyright notice displayed in this document indicates when the document was last issued.

© The British Standards Institution 2024
Published by BSI Standards Limited 2024

ISBN 978 0 539 28917 6

ICS 91.140.50, 29.020, 13.220.01

No copying without BSI permission except as permitted by copyright law.

Publication history

First published March 2024

Contents

Foreword.....	iii
0 Introduction.....	v
1 Scope	1
2 Normative references	2
3 Terms, definitions and abbreviated terms	4
3.1 Terms and definitions.....	4
3.2 Abbreviated terms.....	6
4 Electrical installation	7
4.1 General requirements.....	7
4.2 Prevention of fire and burns from DC arcs.....	7
5 System controls and integration	8
5.1 System controls.....	8
5.2 Failure modes.....	8
5.3 Identification of controls, indications and warnings.....	9
5.4 Battery management and monitoring system (BMMS) fire safety functions.....	9
6 Storage batteries	10
6.1 Access and basic mechanical protection.....	10
6.2 General safety requirements.....	10
6.3 Safety of battery assemblies for protection against fire and burns.....	12
6.4 Safety of cells and monobloc batteries.....	13
6.5 Protection against fire.....	14
6.6 Additional protection against mechanical impact.....	16
7 Power conversion equipment (PCE)	17
7.1 Product safety and performance.....	17
7.2 Protection against fire.....	17
7.3 Additional protection against mechanical impact.....	17
8 System marking, notices and instructions	18
8.1 Marking of components.....	18
8.2 System installation warnings and notices.....	18
8.3 User instructions for the system.....	20
9 Verification	21
9.1 Initial verification.....	21

Annexes

Annex A (informative)

Recommended working practices to reduce the risk of fire and explosion	22
A.1 Electrical work on batteries, and DC circuits supplied by batteries	22
A.2 Transportation of battery assemblies.....	22
A.3 Transportation of cells and monobloc batteries not part of a battery assembly.....	22
A.4 Securing batteries in a vehicle during transportation	22

Annex B (informative)

Example checklist for verification against PAS 63100	23
---	----

Annex C (informative)

Suggested statement of conformity	28
--	----

Bibliography	30
---------------------------	----

List of figures

Figure 1 – Examples of conformant and non-conformant arrangement of batteries.....	11
Figure 2 – Symbol indicating the presence of both solar PV and BESS in a building.....	18
Figure 3 – Symbol indicating the presence of BESS in a building	19
Figure 4 – Examples of instruction notices required by 8.2.2	19

List of tables

Table 1 – Examples of system failure mode monitoring and actions	8
Table 2 – Battery enclosure requirements based on determined arc flash incident energy.....	12
Table 3 – Installation location requirements of assemblies based on determined arc flash incident energy	13
Table 4 – Standards for cells and monobloc batteries.....	13
Table 5 – Locations requiring protection against mechanical impact	16
Table 6 – Requirements for system user instructions.....	20
Table B.1 – PAS 63100 verification checklist.....	23
Table C.1 – PAS 63100 suggested statement of conformity	28

Foreword

This PAS was sponsored by the Department for Energy Security and Net Zero. Its development was facilitated by BSI Standards Limited and it was published under licence from The British Standards Institution. It came into effect on 31 March 2024.

Acknowledgement is given to Graham Kenyon as the technical author, and the following organizations that were involved in the development of this PAS as members of the steering group:

- Association For Renewable Energy and Clean Technology (REA)
- British Electrotechnical and Allied Manufacturers' Association (BEAMA)
- Certi-fi Schemes Ltd.
- Certsure LLP
- Consumer Public Interest Network (CPIN)
- Department for Energy Security and Net Zero (DESNZ)
- Electrical Contractors' Association (ECA)
- Electrical Safety First (ESF)
- G Kenyon Technology Ltd.
- Institution of Engineering and Technology (IET)
- Loughborough University
- Microgeneration Certification Scheme (MCS)
- National Association of Professional Inspectors and Testers (NAPIT)
- National Fire Chiefs Council (NFCC)
- Newcastle University
- Office for Product Safety and Standards (OPSS)
- Powervault Ltd.
- Tesla Inc.

Acknowledgement is also given to the members of a wider review panel who were consulted in the development of this PAS.

The British Standards Institution retains ownership and copyright of this PAS. BSI Standards Limited as the publisher of the PAS reserves the right to withdraw or amend this PAS on receipt of authoritative advice that it is appropriate to do so. This PAS will be reviewed at intervals not exceeding two years.

This PAS is not to be regarded as a British Standard. It will be withdrawn in the event it is superseded by a British Standard.

The PAS process enables a specification to be rapidly developed in order to fulfil an immediate need in industry. A PAS can be considered for further development as a British Standard, or constitute part of the UK input into the development of a European or International Standard.

Information about this document

This publication can be withdrawn, revised, partially superseded or superseded. Information regarding the status of this publication can be found in the Standards Catalogue on the BSI website at [bsigroup.com/standards](https://www.bsigroup.com/standards), or by contacting the Customer Services team.

Where websites and webpages have been cited, they are provided for ease of reference and are correct at the time of publication. The location of a webpage or website, or its contents, cannot be guaranteed.

Presentational conventions

The provisions of this PAS are presented in roman (i.e. upright) type. Its requirements are expressed in sentences in which the principal auxiliary verb is "shall".

Commentary, explanation and general informative material is presented in smaller italic type, and does not constitute a normative element.

Where words have alternative spellings, the preferred spelling of the *Shorter Oxford English Dictionary* is used (e.g. "organization" rather than "organisation").

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

Compliance with a PAS cannot confer immunity from legal obligations.

In particular, attention is drawn to the following specific regulations:

- The Electricity Safety, Quality and Continuity Regulations 2002, Part VI: Generation, 21. Switched alternate sources of energy and 22. Parallel operation [1]; and
- The Carriage of Dangerous Goods and Use of Transportable Pressure Equipment Regulations 2009 (CDG) [2].

0 Introduction

Electrical energy (battery) storage forms a key part of renewable energy strategies. Given the benefits of electrical energy storage systems (EESSs) to consumers and electricity providers, and their ability to maximize the effectiveness of renewable energy technologies such as solar photovoltaic (PV) systems, it is expected that there will be a sharp rise in the number of EESSs being installed.

This specification aims to help installers manage fire safety related hazards associated with EESSs in homes in the United Kingdom. The provisions are intended to reduce the risk of batteries in dwellings becoming a source of ignition, and limit the impact of a battery fire should one occur.

Regarding battery location, the basic premise is that the best place for storage batteries is outside dwellings and away from habitable rooms. Where it is not practicable to locate batteries outdoors, some basic requirements are provided for locations containing storage batteries, based on the principles that:

- batteries are separated from habitable rooms, and means of escape for inhabitants, by suitable fire compartmentation;
- fire detection is provided for the battery location, interlinked to a fire alarm system to warn inhabitants of a detected fire; and
- means of escape for inhabitants are not inhibited.

Whilst battery fires, at the time of writing, are low frequency, they have a high impact due to their behaviour in fire. Since some batteries can exhibit focussed jet-like flaming, a higher degree of fire compartmentation should be considered. Fire compartmentation requirements might need to be assessed in future editions of this standard, as there are currently gaps in the knowledge of how fire compartmentation resists lithium battery fires.

This specification is also based on the premise that electrical energy storage systems competent persons are defined in accordance with the Building Regulations Approved Documents of England or the relevant devolved national equivalents in Wales, Scotland and Northern Ireland.

The United States National Fire Protection Association (NFPA) document, NFPA 855, *Standard for the installation of stationary energy storage systems* [3] was used as a guide when developing requirements for storage battery installation locations, and maximum values of stored energy.

This page is deliberately left blank.

1 Scope

This PAS specifies requirements for fire safety in the installation of small-scale electrical energy storage systems (EESSs) in domestic dwellings that utilize stationary secondary batteries as the medium for energy storage.

The PAS defines fire safety requirements for the installation of EESS components including:

- physical requirements for battery units;
- battery management;
- power conversion equipment (PCE); and
- fault management and fail-to-safe operation of all control and monitoring functions.

The PAS covers installation requirements for:

- installation location in respect of safety and external factors that affect fire safety; and
- protection against fire.

The PAS does not cover:

- battery systems with nominal voltages on the AC and/or DC side exceeding low voltage as defined in BS 7671;
- secondary batteries with total capacity not exceeding 150 Wh incorporated into products or systems that are the subject of harmonized or designated standards (e.g. intruder alarm systems, carbon monoxide alarm systems, fire detection and alarm systems, pluggable uninterruptible power systems, portable appliances, audio/video and information technology equipment);
- domestic dwellings exceeding 200 m² in floor area;
- transportation of batteries;
- systems incorporating second life batteries;
- EESSs that use alternative forms of energy storage;
- EESSs in high risk residential buildings; and
- EESSs connected before a distributor's cut-out or a consumer's meter (collective PEI).

NOTE 1 Existing regulations, *The Carriage of Dangerous Goods and Use of Transportable Pressure Equipment Regulations 2009 (CDG)[2]*, cover the transportation of batteries.

NOTE 2 Attention is drawn to BS 7671, Section 511 regarding the product standards for selected electrical equipment and its intended use.

NOTE 3 The fire safety principles can also be applied to domestic dwellings exceeding 200 m²; however, it is recommended that a fire safety expert is consulted.

NOTE 4 Second life batteries are excluded because there are currently no standards in place to address safety of repurposed batteries. Aligning with BS 7671, this PAS requires batteries to conform to a suitable safety standard relevant for the application (see 6.4). At the time of development of this PAS, the typical application for second life batteries for domestic storage systems comprises second-life electric vehicle traction batteries, and the designer of an electrical installation (perhaps the installer for domestic installations) would therefore be required to make a suitable declaration regarding safety according to Regulation 511.2 of BS 7671.

The PAS is of use to suitably competent designers and installers of EESSs forming part of electrical installations of dwellings and similar simple electrical installations.

This PAS might be of interest to manufacturers of products forming part of an installed EESS and bodies providing independent certification of products, design and installation of an EESS.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes provisions of this PAS. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

BS 476 series, *Fire tests on building materials and structures*

BS 5839 series, *Fire detection and fire alarm systems for buildings*¹⁾

BS 7671, *Requirements for electrical installations*

BS EN 54 series, *Fire detection and fire alarm systems*

BS EN 13501 series, *Fire classification of construction products and building elements*

BS EN 60073, *Basic and safety principles for man-machine interface, marking and identification – Coding principles for indicators and actuators*

BS EN 60529, *Degrees of protection provided by enclosures (IP Code)*

BS EN 60622, *Secondary cells and batteries containing alkaline or other non-acid electrolytes – Sealed nickel-cadmium prismatic rechargeable single cells*

BS EN 60623, *Secondary cells and batteries containing alkaline or other non-acid electrolytes – Vented Nickel-cadmium prismatic rechargeable single cells*

BS EN 61427-1, *Secondary cells and batteries for renewable energy storage – Part 1: General requirements and methods of test – Photovoltaic off-grid application*

BS EN 61427-2, *Secondary cells and batteries for renewable energy storage – Part 2: General requirements and methods of test – On-grid applications*

BS EN 62109-2, *Safety of power converters for use in photovoltaic power systems – Part 2: Particular requirements for inverters*

BS EN 62116, *Utility-interconnected photovoltaic inverters – Test procedure of islanding prevention measures*

BS EN 62262, *Degrees of protection provided by enclosures for electrical equipment against external mechanical impacts (IK code)*

BS EN 62477-1, *Safety requirements for power electronic converter systems and equipment – Part 1: General*

BS EN IEC 61204-3, *Low-voltage switch mode power supplies – Part 3: Electromagnetic compatibility (EMC)*

BS EN IEC 61204-7, *Low-voltage switch mode power supplies – Part 7: Safety requirements*

BS EN IEC 62485-1, *Safety requirements for secondary batteries and battery installations – Part 1: General safety information*

BS EN IEC 62485-2, *Safety requirements for secondary batteries and battery installations – Part 2: Stationary batteries*

¹⁾ This document also gives a normative reference to BS 5839-6.

BS EN IEC 62485-5, *Safety requirements for secondary batteries and battery installations – Part 5: Safe operation of stationary lithium ion batteries*

BS EN IEC 62933-5-2, *Electrical energy storage (EES) systems. Part 5-2: Safety requirements for grid-integrated EES systems – Electrochemical-based systems*

BS EN IEC/IEEE 82079-1, *Preparation of information for use (instructions for use) of products – Part 1: Principles and general requirements*

IEC 60417, *Graphical symbols for use on equipment*

ISO 7000, *Graphical symbols for use on equipment*

3 Terms, definitions and abbreviated terms

3.1 Terms and definitions

For the purposes of this PAS, the following terms and definitions apply.

3.1.1 battery

one or more cells fitted with devices necessary for use, for example; case, terminals, marking and protective devices

[SOURCE: IEC 60050, IEV Ref 482-01-04]

3.1.2 battery monitoring and management system (BMMS)

system comprising different equipment and devices in the installation for the purpose of monitoring and managing the charging, discharging and health state of a battery

3.1.3 cell

basic functional unit, consisting of an assembly of electrodes, electrolyte, container, terminals and usually separators, that is a source of electric energy obtained by direct conversion of chemical energy

[SOURCE: IEC 60050, IEV Ref 482-01-01]

3.1.4 collective PEI

several consuming electrical installations connected to the same public distribution network and sharing one common set of local power supplies and energy storage equipment

[SOURCE: BS HD 60364-8-2]

3.1.5 consumer

<of electricity> entity or party which uses electricity for its own needs

[SOURCE: BS HD 60364-8-2]

3.1.6 dwelling

unit of residential accommodation occupied (whether or not as a sole or main residence):

- a) by a single person or by people living together as a family; or
- b) by not more than six residents living together as a single household, including a household where care is provided for residents; or
- c) by persons who do not live together as a family, but who live in self-contained single-family flats, maisonettes or bedsits within the unit; or
- d) as a shared house.

[SOURCE: BS 5839-6, modified, Note omitted]

3.1.7 individual PEI

single consuming and/or producing electrical installation

[SOURCE: BS HD 60364-8-2]

3.1.8 monobloc battery

battery with multiple separate but electrically connected cell compartments each of which is designed to house an assembly of electrodes, electrolyte, terminals or interconnections and possible separators

NOTE 1 The cells in a monobloc battery can be connected in series or in parallel.

[SOURCE: IEC 60050, IEV Ref 482-02-17]

NOTE 2 Monobloc batteries for some battery chemistries might contain some protective measures, for example cell monitoring and charge control features, but do not typically include internal protection against overcurrent. Where all features are provided, including protection against overcurrent, the term “battery” is used in this PAS.

3.1.9 power conversion equipment (PCE)

electrical device converting one kind of electrical power from a voltage or current source into another kind of electrical power with respect to voltage, current and frequency

NOTE Examples include AC-DC converters, DC-AC converters, DC-DC charge controllers, frequency converters, and hybrid devices that carry out a combination of such functions.

[SOURCE: BS EN 62109-1, 3.66, Note modified]

3.1.10 producer

<of electricity> party generating electrical energy

[SOURCE: IEC 60050-617:2009, IEV Ref 617-02-01]

3.1.11 prosumer

entity or party which can be both a producer and a consumer of electrical energy

[SOURCE: BS HD 60364-8-2]

3.1.12 prosumer’s electrical installation (PEI)

low-voltage electrical installation connected or not to a public distribution network able to operate:

- with local power supplies, and/or
- with local storage units,

and that monitors and controls the energy from the connected sources delivering it to:

- current-using equipment, and/or
- local storage units, and/or
- public distribution network.

[SOURCE: BS HD 60364-8-2]

3.1.13 secondary cell

cell which is designed to be electrically recharged

NOTE The recharge is accomplished by way of a reversible chemical reaction.

[SOURCE: IEC 60050-482: IEV Ref 482-01-03]

3.1.14 shared PEI

several consuming and/or producing electrical installations similar to an individual PEI connected to the same low-voltage public distribution network and sharing their individual power supplies and energy storage equipment between themselves

[SOURCE: BS HD 60364-8-2]

3.1.15 smart grid

electric power system that utilizes information exchange and control technologies, distributed computing and associated sensors and actuators, for purposes such as:

- to integrate the behaviour and actions of the network users and other stakeholders; and
- to efficiently deliver sustainable, economic and secure electricity supplies.

[SOURCE : IEC 60050-617:2011, IEV Ref 617-04-13]

3.2 Abbreviated terms

For the purposes of this PAS, the following abbreviated terms apply.

IK international mechanical impact protection code (in accordance with BS EN 62262)

IP international ingress protection code (in accordance with BS EN 60529)

4 Electrical installation

4.1 General requirements

4.1.1 The battery shall be selected and erected in accordance with BS 7671.

NOTE Guidance on installations incorporating electrical energy storage, and the application of BS 7671 to such systems, is given in the IET Code of practice for electrical energy storage systems [4].

4.1.2 Where battery assemblies are connected in parallel strings, and are in one or more separate enclosures, common protection against overcurrent shall be provided.

4.2 Prevention of fire and burns from DC arcs

COMMENTARY ON 4.2

The provisions of this subclause are intended to prevent persons without requisite electrical knowledge unintentionally or intentionally causing an electrical arc, which might lead to fire and burns.

4.2.1 It shall not be possible to remove DC power cable connections without:

- a) the use of a tool; or
- b) removing a cover secured by the use of a tool.

4.2.2 Fuses for DC circuits of batteries shall be:

- a) accessible only by the use of a tool; or
- b) arranged so that fuses are only capable of being removed after opening an isolator suitable for on-load isolation.

5 System controls and integration

5.1 System controls

5.1.1 System controls shall conform to BS EN IEC 62933-5-2.

5.1.2 The system shall include a battery management and monitoring system (BMMS).

5.2 Failure modes

Where the system manufacturer has included monitoring of the battery, it shall monitor for suitable conditions to detect the failure modes, and undertake appropriate actions.

For those systems that are installed within a dwelling, an audible warning shall be used for battery persistent dangerous condition. For systems installed outdoors, remote monitoring via an app may be used.

NOTE 1 Examples of system failure mode monitoring and actions are listed in Table 1.

NOTE 2 Refer to 6.5 for information on requirements for fire detection and fire alarm.

Table 1 – Examples of system failure mode monitoring and actions

Condition or failure mode	Indication	System action
Battery internal fault (conditions based on manufacturer's risk assessments)	Visual indication	Battery should be disconnected from PCE
Battery dangerous condition (for example, battery overtemperature, or other condition that could lead to fire, thermal runaway, or evolution of explosive vapours or gases)	Visual warning and audible warning	Battery should be disconnected from PCE
Battery persistent dangerous condition (for example, battery overtemperature and temperature not falling after a period of 2 minutes following disconnection of PCE, or other condition that indicates a thermal runaway dependent on battery chemistry.)	Visual warning and audible warning	Battery fire suppression should be activated (if provided as part of the system)

5.3 Identification of controls, indications and warnings

Controls, indications and warnings (including audible warnings) shall follow the principles of BS EN 60073. Symbols or icons shall be selected from ISO 7000 or IEC 60417.

5.4 Battery management and monitoring system (BMMS) fire safety functions

Interfaces with fire detection and alarm systems and fire suppression systems shall conform to relevant parts of BS 5839 series and BS EN 54 series.

6 Storage batteries

6.1 Access and basic mechanical protection

6.1.1 Batteries shall comprise non-combustible enclosures containing the overcurrent protection with the cells/monoblocs.

NOTE 1 Ferrous metal, e.g. steel, is deemed to be an example of a non-combustible material.

NOTE 2 Figure 1 shows examples of conformant and non-conformant arrangement of cells and monoblocs.

6.1.2 Access to the interior of the battery enclosure shall be possible only by use of a tool. When installed, the top surface of battery enclosures shall meet IP4X or IPXX/D in accordance with BS EN 60529.

6.1.3 The total energy stored by batteries within a single enclosure shall not exceed 20 kWh.

6.2 General safety requirements

6.2.1 Battery enclosure assemblies shall conform to BS EN IEC 62485-1, BS EN IEC 62933-5-2, and:

- a) BS EN IEC 62485-2 for lead-acid, nickel metal hydride and nickel cadmium battery chemistries; and
- b) BS EN IEC 62485-5 for lithium-ion battery chemistries.


6.2.2 Storage battery systems shall be installed in accordance with BS 7671. Interconnections between separate enclosures in accordance with BS 7671 shall be provided, where necessary, for:

- a) batteries and PCE; and
- b) batteries.

NOTE 1 Guidance on installations incorporating electrical energy storage, and the application of BS 7671 to such systems, is given in the IET Code of practice for electrical energy storage systems [4].

NOTE 2 Recommended working practices to reduce the risk of fire and explosion are provided in Annex A.

Figure 1 – Examples of conformant and non-conformant arrangement of batteries

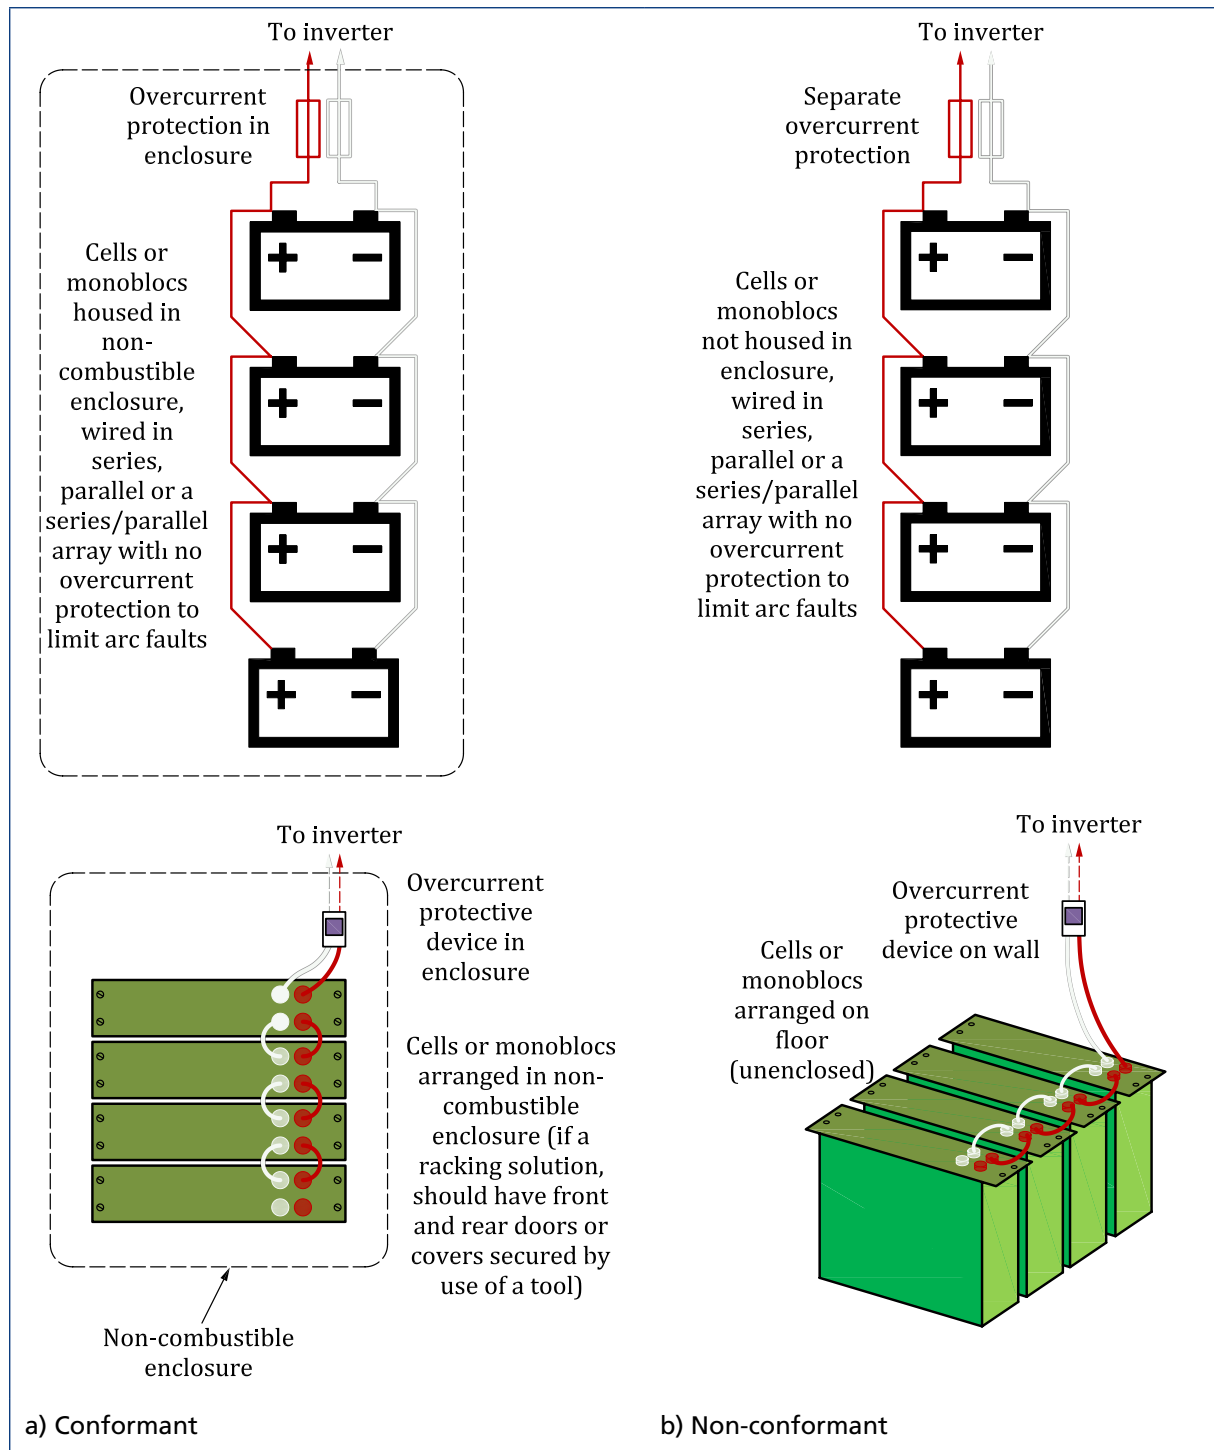

6.3 Safety of battery assemblies for protection against fire and burns

6.3.1 The battery assembly shall be selected from products where the manufacturer has undertaken an assessment of arc flash, fire and explosion risk in accordance with a recognized methodology, and declared the arc flash incident energy in the installation instructions for the battery.

NOTE 1 A methodology for the assessment of arc flash incident energy and arc flash boundary is provided in AS/NZS 5139.

NOTE 2 The battery manufacturer should conduct this assessment, rather than the installer, and make a suitable declaration in the installation instructions for the battery.


6.3.2 The battery assembly shall conform to the stated requirements for the determined arc flash incident energy levels shown in Table 2.

Table 2 – Battery enclosure requirements based on determined arc flash incident energy

Incident energy (cal/cm ²)	Battery enclosure requirements
≥8.0	Battery assemblies with incident energy exceeding 8.0 cal/cm ² are not considered suitable for electrical installations associated with dwellings and shall not be intentionally supplied for such purpose.
≥4.0, <8.0	The battery shall be capable of being isolated into blocks, each having incident energy <4.0 cal/cm ² . The battery enclosure shall have an equivalent fire protection rating of at least REI 60 to BS EN 13501 series (60 min to BS 476 series for loadbearing capacity and integrity).
≥1.2, <4.0	Access to cells and monobloc batteries shall be possible only with the use of a tool.
NOTE All relevant provisions based on the incident arc flash energy apply.	

6.3.3 The installation location of battery assemblies shall be based on the determined arc flash incident energy in accordance with Table 3.

Table 3 – Installation location requirements of assemblies based on determined arc flash incident energy

Incident energy (cal/cm ²)	Installation requirements
≥8.0	<p>Battery assemblies with incident energy exceeding 8.0 cal/cm² shall not be installed in electrical installations associated with dwellings. The installation instructions shall contain the following warning, accompanied by the arc flash warning symbol ISO 7010-7010-W042:</p>  <p>WARNING. Risk of electrical arc flash. This battery must not be installed in electrical installations associated with dwellings.</p>
≥4.0, <8.0	<p>The battery installation instructions shall include the following statement:</p> <p>Where this battery is installed in a building, it is recommended that a means of fire detection and alarm, that is interconnected with the fire detection and alarm system of the rest of the building, is installed in the relevant location. Where the building does not already incorporate an interlinked fire detection and alarm system, it is strongly recommended that one is fitted when this battery is installed. Such systems are subject to the provisions of the relevant UK devolved national Approved Codes of Practice and guidance on building regulations, and the relevant parts of BS 5839.</p>
<i>NOTE All relevant provisions based on the incident arc flash energy apply.</i>	

6.4 Safety of cells and monobloc batteries

Cells and monobloc batteries shall conform to the relevant safety standards dependent on battery chemistry as shown in Table 4.

Table 4 – Standards for cells and monobloc batteries

Battery chemistry	Applicable standard(s)
Lithium	BS EN IEC 62281
Nickel-cadmium	BS EN 60622; or BS EN 60623; or BS EN 62259.
Nickel-metal hydride	BS EN 62675
Lead-acid	BS EN 61056-1; and BS EN 61056-2.

6.5 Protection against fire

6.5.1 Where practicable, storage batteries shall be installed outdoors. Where it is not practicable to install storage batteries outdoors, batteries shall only be installed indoors at a location:

- a) not precluded by **6.5.5**;
- b) with ventilation according to **6.5.4**; and
- c) with fire resisting separation where required by **6.5.3**.

***NOTE** Outdoors can be an out building not intended for habitation that is detached or separated by main wall with a minimum fire performance of REI 120 to BS EN 13501.*

6.5.2 Where a battery energy storage system (BESS) is installed on the external wall of the building it shall not compromise the fire performance of the external wall. Service penetrations shall be adequately fire stopped and internal combustible substrates shall not become exposed by the installation. Where wall cavities exist, cavity barriers shall be provided for services passing through the wall.

***NOTE** In certain cases, equipment mounted on an external wall could require planning consent, and/or be notifiable in accordance with local authority building control procedures.*

6.5.3 Any indoor location in which storage batteries or storage battery enclosures are installed shall have fire resisting separation from indoor locations identified in **6.5.5** by walls, ceilings and floors with a fire performance of at least REI 30 to BS EN 13501 series (30 min to BS 476 series for loadbearing capacity, integrity and insulation).

***NOTE 1** As per Building Regulations Approved Documents in England and Wales, and Scottish Building Technical Handbooks, all services passing through the fire resisting enclosure where a storage battery or storage battery enclosure are installed should be adequately fire stopped to maintain the fire resisting separation. See also Regulation 527.2 of BS 7671.*

***NOTE 2** Fire compartmentation requirements might need to be assessed in future editions of this standard, as there are currently gaps in the knowledge of how fire compartmentation resists lithium battery fires.*

6.5.4 All indoor locations which contain storage batteries shall have fresh-air ventilation to outdoors. Ventilation systems for the location shall not compromise the fire resistance of the enclosure. The edges of outdoor port for such ventilation shall be at least 1 m from the edges of:

- a) doors;
- b) windows; or
- c) ventilation ports for other locations.

***NOTE 1** Guidance on and further requirements for ventilation are provided in BS EN IEC 62485 series.*

***NOTE 2** Air tightness requirements for dwellings might preclude batteries being installed in habitable parts off a dwelling.*

6.5.5 Batteries shall not be installed in any of the following locations:

- a) rooms in which persons are intended to sleep;
- b) routes used as a means of escape that are not defined as protected escape routes, including landings, staircases and corridors;
- c) corridors, shafts, stairs or lobbies of protected escape routes;

- d) firefighting lobbies, shafts or staircases;
- e) storage cupboards, enclosures or spaces opening into rooms in which persons are intended to sleep;
- f) outdoors (ground-mounted or wall-mounted in a suitable enclosure) within 1 m of:
 - 1) escape routes;
 - 2) doors;
 - 3) windows; or
 - 4) ventilation ports.
- g) voids, roof spaces or lofts;
- h) within 2 m of stored flammable materials and fuel storage tanks or cylinders; and
- i) cellars or basements that have no access to the outside of the building.

6.5.6 Where batteries are installed in locations in dwellings that are infrequently visited, such as store cupboards, a smoke detector/alarm or multi-sensor fire detector/fire alarm shall be installed in that location, and shall be interlinked with a fire detection and fire alarm system in the remainder of the dwelling. Fire detection and alarm systems shall conform to BS 5839-6.

***NOTE 1** Premises whose electrical installation incorporates a BESS should have an appropriate fire detection and fire alarm system of at least Grade D2, Category LD2. In existing premises, this might involve provision of a new system, or upgrade to an existing system, when a BESS is installed.*

***NOTE 2** A Category LD2 system incorporates smoke detector/alarms or multi-sensor fire detector/fire alarms covering any specified rooms or areas that present a high fire risk to occupants in addition to covering means of escape..*

***NOTE 3** The designer of the fire alarm system should provide for adequate fire detection coverage to detect smoke and/or heat due to a fire in a battery installed indoors.*

6.5.7 The total stored energy of all units in an individual dwelling house shall not exceed:

- a) 80 kWh where batteries are installed in one of the following locations:
 - 1) detached garage or outbuilding;
 - 2) outdoors (ground-mounted or wall-mounted); or
 - 3) attached garage or outbuilding that has a fire separation with a performance of at least REI 60 to BS EN 13501 series (60 min to BS 476 series for loadbearing capacity, integrity and insulation); or
- b) 40 kWh in all other cases.

***NOTE** The fire resistance in this requirement is related to the actual stored energy in the installation. The focus of the fire safety principles is to provide an early warning rather than improving the compartmentation.*

6.6 Additional protection against mechanical impact

Storage batteries installed in the locations listed in Table 5 shall have a minimum degree of protection against external mechanical impact of IK10 in accordance with the requirements of BS EN 62262, or be provided with equivalent protection by general local mechanical impact protection.

NOTE Examples of general local mechanical impact protection include impact barriers, or enclosures offering equivalent mechanical protection.

Table 5 – Locations requiring protection against mechanical impact

Outdoor locations (ground-mounted, or wall-mounted at a height not exceeding 5.8 m)	Indoor locations (floor-mounted or wall-mounted)
Adjacent to a driveway or other vehicle parking or movement area	Within an attached or detached garage
On walls adjoining public highways	Adjacent to other indoor car parking spaces

NOTE 1 This table references mechanical impact described in 6.7 and 7.3.

NOTE 2 Installation of battery storage equipment and/or general local impact protection in some of the locations listed in this table might be subject to planning restrictions. This might make the location unsuitable for installation of storage batteries, and another location should be selected.

7 Power conversion equipment (PCE)

7.1 Product safety and performance

PCE shall conform to the following standards:

- a) Inverters:
 - 1) BS EN 62109-2.
- b) DC-DC converters and battery charging equipment (other than that incorporated into an inverter):
 - 1) BS EN 62477-1; or
 - 2) BS EN IEC 61204-7 and BS EN IEC 61204-3.

7.2 Protection against fire

Where PCE is installed in loft spaces, store cupboards or other infrequently visited locations, a smoke detector/alarm or multi-sensor fire detector/fire alarm shall be installed in that location, and interlinked with a fire detection and fire alarm system in the remainder of the dwelling. Fire detection and alarm systems shall conform to BS EN 5839-6.

***NOTE 1** Premises whose electrical installation incorporates a BESS should have an appropriate fire detection and fire alarm system of at least Grade D2, Category LD2. In existing premises, this might involve provision of a new system, or upgrade to an existing system, when a battery EESS is installed.*

***NOTE 2** A Category LD2 system incorporates smoke detector/alarms or multi-sensor fire detector/fire alarms covering any specified rooms or areas that present a high fire risk to occupants in addition to covering means of escape.*

7.3 Additional protection against mechanical impact

PCE installed in the locations listed in Table 5 shall have a minimum degree of protection against external mechanical impact of IK08 in accordance with the requirements of BS EN 62262, or be provided with equivalent protection by general local mechanical impact protection.

***NOTE** Examples of general local mechanical impact protection include barriers or enclosures offering equivalent mechanical protection.*

8 System marking, notices and instructions

8.1 Marking of components

All system components shall be marked in accordance with their respective product standard.

8.2 System installation warnings and notices

8.2.1 Warning notices and user instruction notices shall be provided in accordance with BS 7671.


8.2.2 An instruction notice indicating the presence of a battery storage system shall be fixed:

- a) at the origin of the electrical installation;
- b) at the metering position, if remote from the origin; and
- c) at the consumer unit or distribution board to which the AC supply from the inverter is connected.

The instruction notice shall conform to BS EN IEC/IEEE 82079-1, and incorporate one of the symbols shown in Figure 2 and Figure 3.

NOTE Examples of instruction notices are shown in Figure 4.

Figure 2 – Symbol indicating the presence of both solar PV and BESS in a building

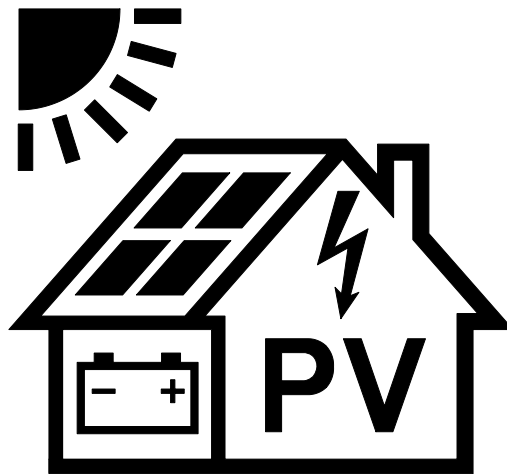

NOTE Adapted from IEC 60417-6400 and ISO 7000-0242.

Figure 3 – Symbol indicating the presence of BESS in a building


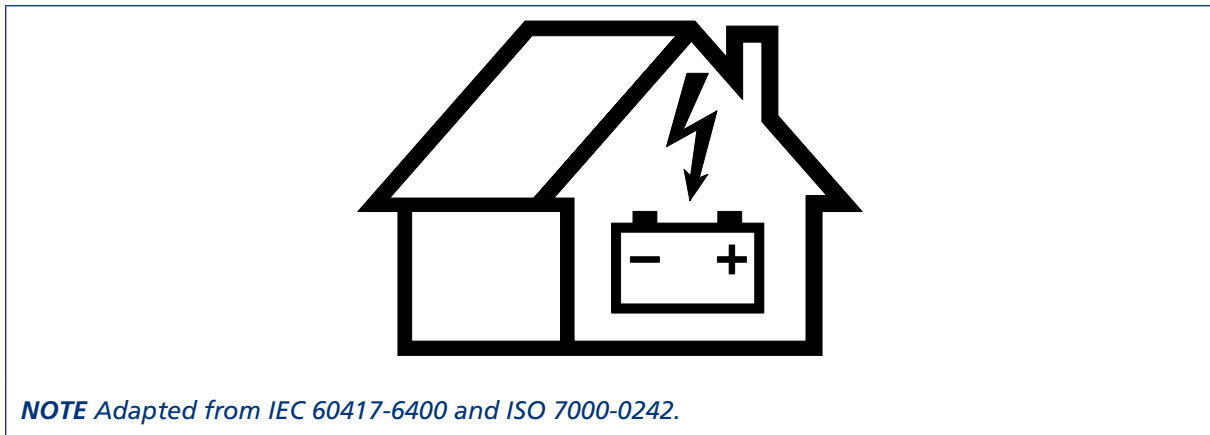


Figure 4 – Examples of instruction notices required by 8.2.2

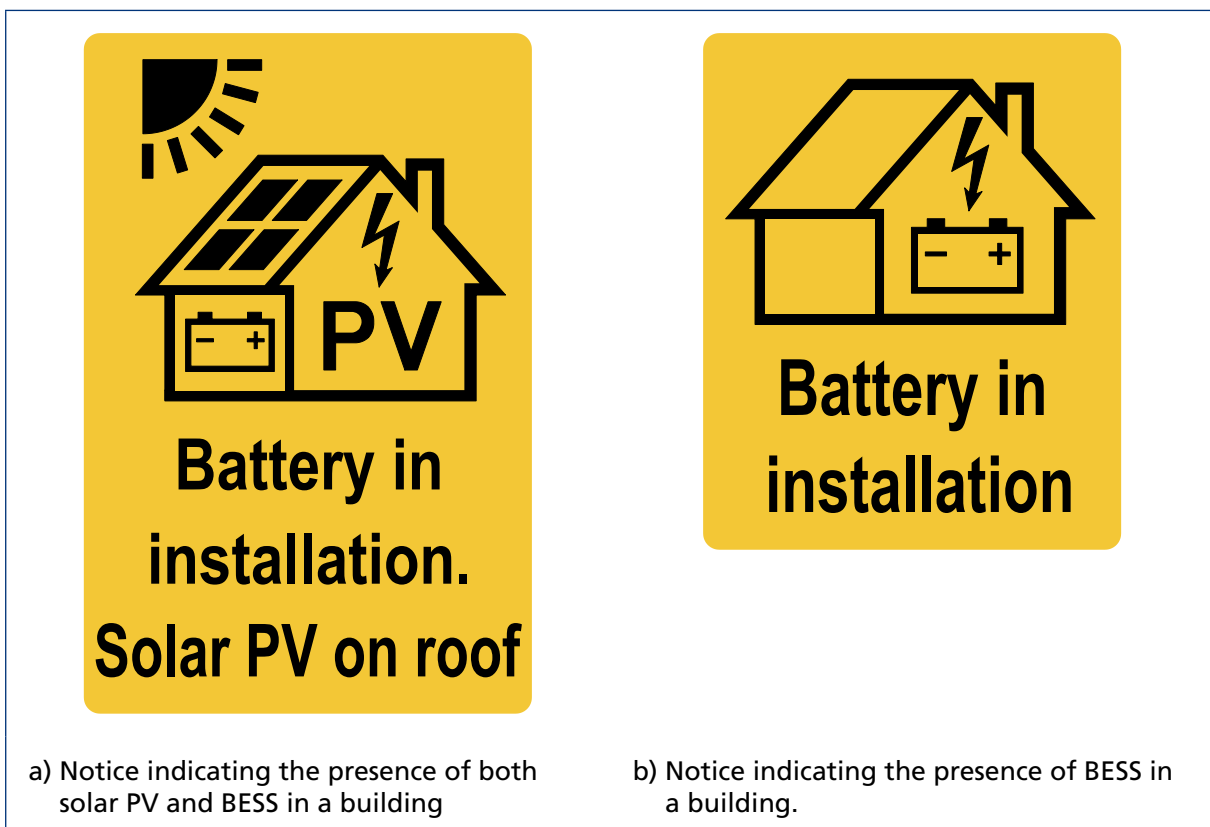

8.3 User instructions for the system

User instructions shall conform to BS EN IEC/IEEE 82079-1. They shall contain, as a minimum, the information shown in Table 6.

Table 6 – Requirements for system user instructions

Subject	Information to be provided
Operational procedures	Start-up procedures Shutdown procedures Meaning of indications, alarms and fault codes Contact details for help, repair, maintenance and warranty
Emergency procedures	Procedure for safe shutdown by users Procedure for users in case of battery fire
Products	Manufacturer's user instructions
Installation	Initial verification checklist and associated documentation

9 Verification

9.1 Initial verification

The installer of the battery storage system shall provide a statement of conformity against this PAS following initial verification which shall be appended to the certification for initial verification in accordance with BS 7671.

NOTE 1 *An example of a checklist for initial verification against the requirements of this PAS is included in Annex B.*

NOTE 2 *A suggested statement of conformity is provided in Annex C.*

Annex A (informative)

Recommended working practices to reduce the risk of fire and explosion

A.1 Electrical work on batteries, and DC circuits supplied by batteries

In order to minimize the risk of arcs and overheating by short-circuit when working on batteries or DC circuits supplied by batteries, appropriate safe working practices should be adopted regardless of the operating voltage. Considerations include:

- a) safe isolation procedures, as far as practicable;
- b) separation of strings when working in battery enclosures to reduce the risk of arc flash;
- c) use of insulated tools;
- d) use of suitable fused test leads and fused test equipment; and
- e) observing safe working distances from monobloc batteries and cells, and use of personal protective equipment against arc flash, selected for the appropriate arc flash incident energy level.

A.2 Transportation of battery assemblies

Prior to transportation for repair, replacement or recycling, batteries should be discharged in accordance with the manufacturer's instructions.

Where battery assemblies are transported, the battery manufacturer's instructions should be taken into account.

A.3 Transportation of cells and monobloc batteries not part of a battery assembly

Prior to transportation for repair, replacement or recycling, cells and monobloc batteries should be discharged in accordance with the manufacturer's instructions.

Cells or monobloc batteries should be transported in transport packaging selected taking into account the battery manufacturer's instructions.

A.4 Securing batteries in a vehicle during transportation

Battery assemblies, and packaging should be secured in a vehicle in which it is being transported, to reduce the risk of damage due to movement and impact in transit.

NOTE *The battery manufacturer's instructions might provide guidance on securing the battery in transit.*

Annex B (informative)

Example checklist for verification against PAS 63100

The checklist in Table B.1 may be used for initial verification of a battery storage system according to the requirements of PAS 63100.

Table B.1 – PAS 63100 verification checklist

Clause	Subject	Means of verification	Confo- rman	Non- conformant	Not applicable	Verifier notes
4 Electrical installation						
4.1.1	Battery installed in accordance with BS 7671	Inspection and test in accordance with BS 7671. An Electrical Installation Certificate and associated schedules of circuit details and test results should be provided <i>NOTE Details of the extent of the installation, and installation location, should be provided on the Electrical Installation Certificate produced in accordance with the guidance in BS 7671, Appendix 6 and referenced in "Verifier notes"</i>	<input type="checkbox"/>	<input type="checkbox"/>		<i>Insert reference(s) of documentation:</i>
4.1.2	Overcurrent protection of parallel strings of batteries	Inspection	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
4.2.1	Access to DC connections	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
4.2.2	Access to DC fuses	Inspection	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
5 System controls and integration						
5.1.1	System controls to BS EN IEC 62933-5-2	Inspection or manufacturer conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
5.1.2	System includes a BMMS	Functional test or manufacturer conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		

Table B.1 – PAS 63100 verification checklist (*continued*)

Clause	Subject	Means of verification	Conformant	Non-conformant	Not applicable	Verifier notes
5.2	Failure mode indications and warnings	Functional test or manufacturer conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
5.3	Identification of controls, indications and warnings	Inspection or manufacturer conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
5.4	Interfaces with fire detection and alarm and fire suppression systems	Manufacturer conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
6 Storage batteries						
6.1.1	Batteries housed in non-combustible enclosures including overcurrent protection	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.1.2	Enclosure accessible only by key or tool, with top surface being IP4X or IPXX/D	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.1.3	Single enclosures not to exceed 20 kWh of storage	Inspection or manufacturer conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
6.2.1	Battery enclosure assemblies conform to BS EN IEC 62933-5-2 and relevant parts of BS EN IEC 62485 series	Inspection of manufacturer's documentation, or conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
6.2.2	Storage battery systems installed in accordance with BS 7671	<i>Verified under 4.1.1</i>				
6.3.1	Arc flash risk assessment	Inspection of manufacturer's documentation, or conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		

Table B.1 – PAS 63100 verification checklist (*continued*)

Clause	Subject	Means of verification	Confo- rman	Non- conformant	Not applicable	Verifier notes
6.3.2	Arc flash incident energy level	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.3.3	Battery location based on arc flash risk assessment	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.4	Battery cell and/or monobloc standard.	Inspection of manufacturer's documentation or conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
6.5.1	Battery located outdoors where practicable	Inspection (If it is not practicable to install batteries in accordance with this requirement, the verifier should provide a reference to the reasons given by the installer)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6.5.2	Batteries on external wall not to compromise fire performance of external wall	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.5.3	Fire resistance of locations where batteries are installed if they cannot be installed outdoors	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.5.4	Ventilation of battery locations if installed indoors	Inspection (not applicable if installed outdoors)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6.5.5	Batteries not to be installed in certain locations	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
6.5.6	Provision of fire detection and fire alarm systems	Inspection (not applicable if batteries are not located in a location visited infrequently)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6.5.7	Limitation of total stored energy in batteries based on location	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		

Table B.1 – PAS 63100 verification checklist (*continued*)

Clause	Subject	Means of verification	Confo- rmanant	Non- conformant	Not applicable	Verifier notes
6.6	Mechanical impact protection	Inspection of manufacturer's documentation or conformity statement (not applicable if batteries are not installed in a location listed in Table 5)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
7 Power conversion equipment (PCE)						
7.1	Product standard for power conversion equipment	Inspection of manufacturer's documentation or conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
7.2	Fire detection and fire alarm for PCE installed in certain locations	Inspection (not applicable if PCE is not located in a location visited infrequently)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
7.3	Mechanical impact requirements for PCE installed in certain locations	Inspection of manufacturer's documentation, or conformity statement provided (not applicable if batteries are not installed in a location listed in Table 5)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
8 System marking, notices and instructions						
8.1	Marking of component products	Inspection of manufacturer's documentation, or conformity statement provided	<input type="checkbox"/>	<input type="checkbox"/>		
8.2.1	Warning and user instruction notices provided in accordance with BS 7671	<i>Verified under 4.1.1</i>				
8.2.2	Instruction notice for the presence of a battery storage system	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		

Table B.1 – PAS 63100 verification checklist (*continued*)

Clause	Subject	Means of verification	Confo- rmanant	Non- conformant	Not applicable	Verifier notes
8.3	System user instructions	Inspection	<input type="checkbox"/>	<input type="checkbox"/>		
<p>Signed: For and on behalf of:</p> <p>Print name:</p> <p>Date:</p>						

Annex C (informative)

Suggested statement of conformity

Table C.1 contains a suggested format of a statement of conformity to PAS 63100 (see 9.1)

Table C.1 – PAS 63100 suggested statement of conformity

Installation address:
Description of battery storage system installed:

Table C.1 – PAS 63100 suggested statement of conformity (*continued*)

<p>I declare that the above-described battery storage system has been verified against the requirements of PAS 63100 and conforms to the requirements of that standard with the following exceptions:</p> <p>.....</p> <p>.....</p> <p>.....</p> <p>.....</p>	
<p>Signed:</p> <p>Print name:</p> <p>Date:</p>	<p>For and on behalf of</p> <p>.....</p> <p>.....</p>

Bibliography

Standards publications

For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

AS/NZS 5139:2019, *Electrical installations – Safety of battery systems for use with power conversion equipment*

BS EN 62109-1, *Safety of power converters for use in photovoltaic power systems – Part 1: General requirements*

BS HD 60364-8-2, *Low-voltage electrical installations – Part 8-2: Prosumer's low-voltage electrical installations*

IEC 60050, *International Electrotechnical Vocabulary (IEV)*

Other publications

- [1] GREAT BRITAIN. The Electricity Safety, Quality and Continuity Regulations 2002, Part VI: Generation, 21. Switched alternate sources of energy and 22. Parallel operation. London: Stationery Office, 2002.²⁾
- [2] GREAT BRITAIN. The Carriage of Dangerous Goods and Use of Transportable Pressure Equipment Regulations 2009 (CDG). London: Stationery Office, 2009.³⁾
- [3] NATIONAL FIRE PROTECTION ASSOCIATION (NFPA). NFPA 855, *Standard for the installation of stationary energy storage systems*. Massachusetts: NFPA, 2023.⁴⁾
- [4] THE INSTITUTION OF ENGINEERING AND TECHNOLOGY (IET). *Code of practice for electrical energy storage systems (EESS)*. London: IET, 2020.⁵⁾

Further reading

DEPARTMENT FOR COMMUNITIES AND LOCAL GOVERNMENT. *The Building Regulations 2010 – Approved Document B, Fire safety, Volume 1: Dwellings*. London: Stationery Office, 2022.⁶⁾

SCOTLAND BUILDING STANDARDS DIVISION. *Building Standards Technical Handbook – Domestic Buildings*. Edinburgh: Scottish Government, 2023.⁷⁾

WELSH GOVERNMENT. *The Building Regulations 2010 – Approved Document B, Fire safety, Volume 1: Dwellinghouses*. Cardiff: Welsh Government, 2020.⁸⁾

²⁾ Available at <https://www.legislation.gov.uk/ukxi/2002/2665/contents/made>

³⁾ Available at <https://www.legislation.gov.uk/ukxi/2009/1348/contents/made>

⁴⁾ Available at <https://www.nfpa.org/codes-and-standards/all-codes-and-standards/list-of-codes-and-standards/detail?code=855>

⁵⁾ Available at <https://shop.theiet.org/cop-for-electrical-energy-storage-systems-2nd-edition-vs>

⁶⁾ Available at <https://www.gov.uk/government/publications/fire-safety-approved-document-b>

⁷⁾ Available at <https://www.gov.scot/publications/building-standards-technical-handbook-april-2024-domestic/>

⁸⁾ Available at <https://www.gov.wales/building-regulations-guidance-part-b-fire-safety>

British Standards Institution (BSI)

BSI is the national body responsible for preparing British Standards and other standards-related publications, information and services.

BSI is incorporated by Royal Charter. British Standards and other standardization products are published by BSI Standards Limited.

About us

We bring together business, industry, government, consumers, innovators and others to shape their combined experience and expertise into standards-based solutions.

The knowledge embodied in our standards has been carefully assembled in a dependable format and refined through our open consultation process. Organizations of all sizes and across all sectors choose standards to help them achieve their goals.

Information on standards

We can provide you with the knowledge that your organization needs to succeed. Find out more about British Standards by visiting our website at bsigroup.com/standards or contacting our Customer Services team or Knowledge Centre.

Buying standards

You can buy and download PDF versions of BSI publications, including British and adopted European and international standards, through our website at bsigroup.com/shop, where hard copies can also be purchased.

If you need international and foreign standards from other Standards Development Organizations, hard copies can be ordered from our Customer Services team.

Subscriptions

Our range of subscription services are designed to make using standards easier for you. For further information on our subscription products go to bsigroup.com/subscriptions.

With **British Standards Online (BSOL)** you'll have instant access to over 55,000 British and adopted European and international standards from your desktop. It's available 24/7 and is refreshed daily so you'll always be up to date.

You can keep in touch with standards developments and receive substantial discounts on the purchase price of standards, both in single copy and subscription format, by becoming a **BSI Subscribing Member**.

PLUS is an updating service exclusive to BSI Subscribing Members. You will automatically receive the latest hard copy of your standards when they're revised or replaced.

To find out more about becoming a BSI Subscribing Member and the benefits of membership, please visit bsigroup.com/shop.

With a **Multi-User Network Licence (MUNL)** you are able to host standards publications on your intranet. Licences can cover as few or as many users as you wish. With updates supplied as soon as they're available, you can be sure your documentation is current. For further information, email cservices@bsigroup.com.

Revisions

Our British Standards and other publications are updated by amendment or revision.

We continually improve the quality of our products and services to benefit your business. If you find an inaccuracy or ambiguity within a British Standard or other BSI publication please inform the Knowledge Centre.

Copyright

All the data, software and documentation set out in all British Standards and other BSI publications are the property of and copyrighted by BSI, or some person or entity that owns copyright in the information used (such as the international standardization bodies) and has formally licensed such information to BSI for commercial publication and use. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI. Details and advice can be obtained from the Copyright & Licensing Department.

Useful Contacts:

Customer Relations	Tel: +44 345 086 9001	Email: cservices@bsigroup.com
Subscription Support	Tel: +44 345 086 9001	Email: subscription.support@bsigroup.com
Knowledge Centre	Tel: +44 20 8996 7004	Email: knowledgecentre@bsigroup.com
Copyright & Licensing	Tel: +44 20 8996 7070	Email: copyright@bsigroup.com



BSI, 389 Chiswick High Road
London W4 4AL, United Kingdom
www.bsigroup.com

